

APP CRS	Rwy Idg	7569
235°	TDZE	726
	Apt Elev	727

RNAV (RNP) Z RWY 23
BUFFALO NIAGARA INTL (BUF)

RNP AR APCH.


For uncompensated Baro-VNAV systems, procedure NA below -18°C or above 54°C. For inop ALSF, increase RNP 0.10 all Cats visibility to 1 ¼. For inop ALSF, increase RNP 0.20 all Cats visibility to 1½. For inop ALSF, increase RNP 0.30 all Cats visibility to 1¾.

ALSF-2



MISSED APPROACH: Climb to 3000 on the RNAV missed approach route to WABUS and hold.

D-ATIS	BUFFALO APP CON	BUFFALO TOWER	GND CON	CLNC DEL	CPDLC
135.35	126.15 263.125	120.5 257.8	133.2 257.8	124.7 257.8	

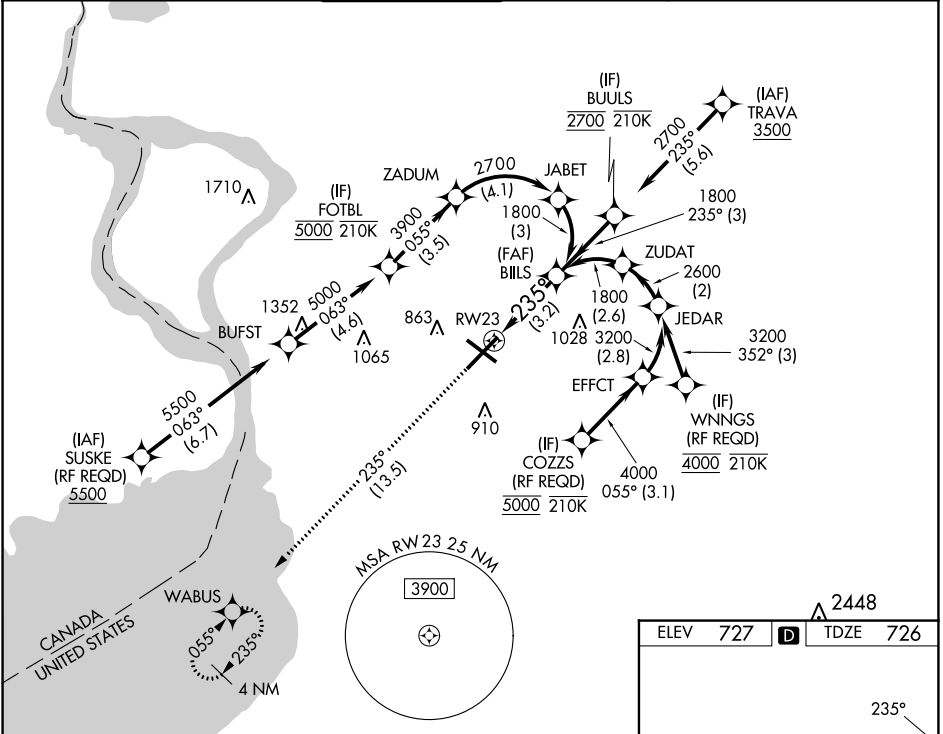

3000

↑

tr 235

WABUS

See planview for multiple IF locations.

RW23

3.2 NM

1800

GP 3.00°

TCH 51

CATEGORY	A	B	C	D
RNP 0.10 DA		1114/45	388 (400-7%)	
RNP 0.20 DA		1170/55	444 (500-1)	
RNP 0.30 DA		1228-1¼	502 (600-1¼)	

AUTHORIZATION REQUIRED

ELEV 727

TDZE 726

2448

235°

820

885

32

REIL Rwy 14

TDZ/CL Rwys 5 and 23

HIRL Rwys 5-23 and 14-32